



SECTION D-D

SECTION C-C


Note: Transition gutter from normal depth of 6" to depth of 9" at inlet in 2'-6".

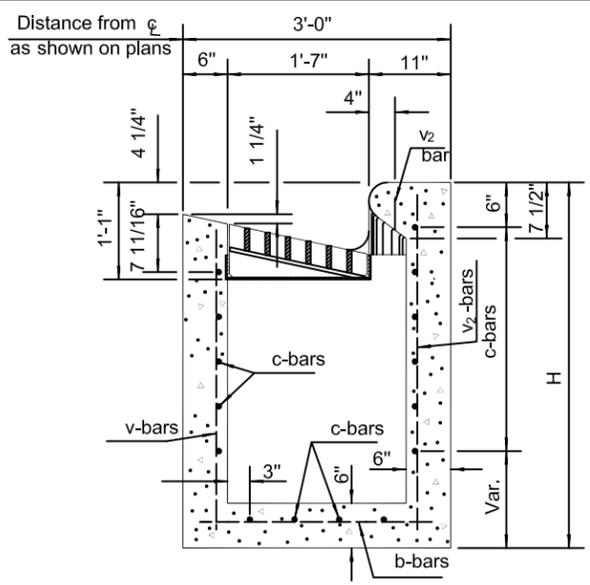




SECTION A-A

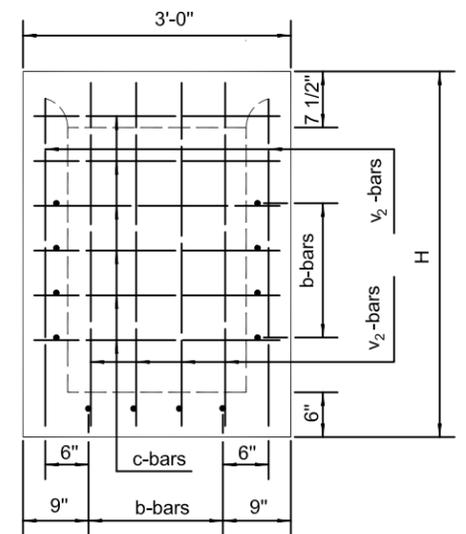

REAR WALL

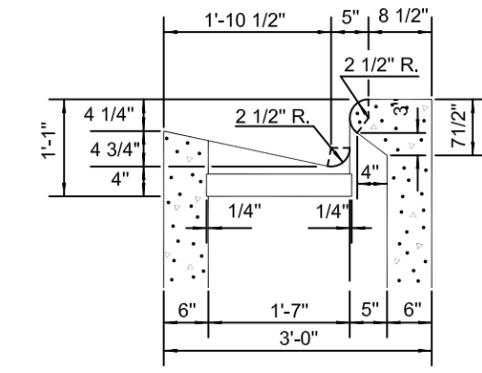

SECTION E-E
(Reinforcing steel not shown.)

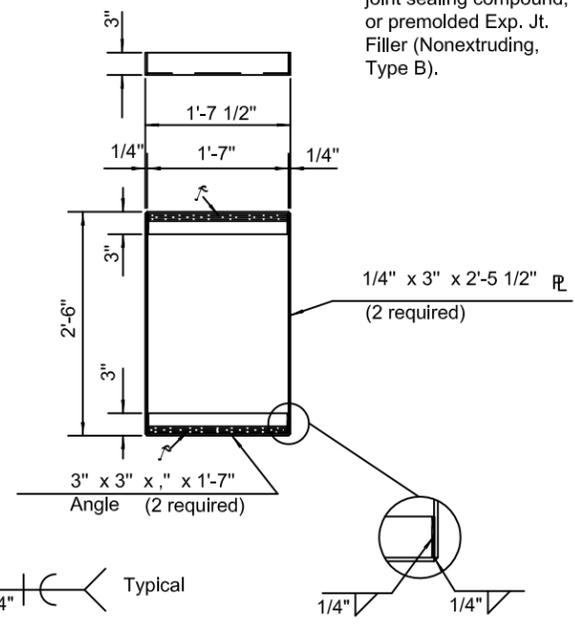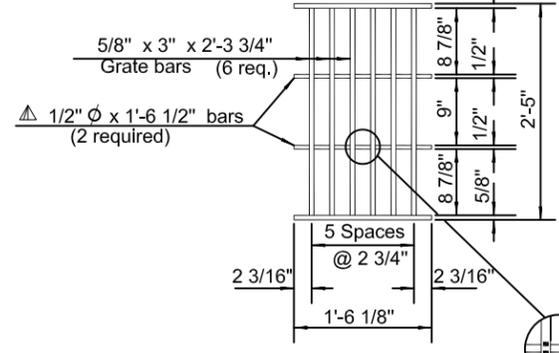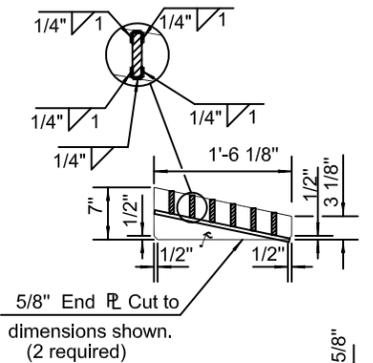


GRATE AND FRAME

Welded Structural Steel Grate & Frame
 ▲ Weight = 152 lbs. Each (With Cross-bars)

Note: To prevent grate from rocking on bearing angles, machine finish surfaces indicated thus " ".

▲ On all interstate projects and rural area projects, the two 1/2" dia x 1'-6 1/16" bars are to be omitted. The weight of the grate and frame without these bars is 150 lbs. of structural steel.

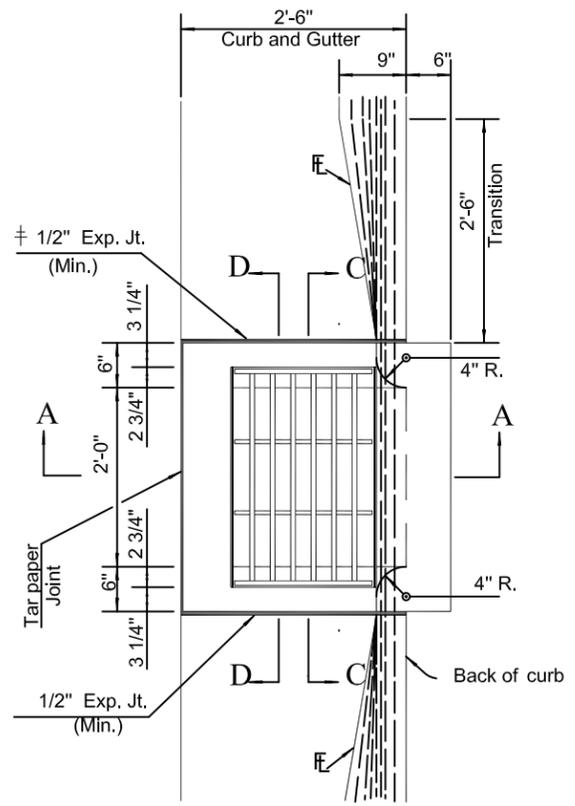

PLAN

Notes: Class A Concrete, Class A Concrete (AE), or the mix used in Concrete Pavement, at the Contractor's option, shall be used throughout. All exposed edges shall be finished with an edging tool. Reinforcing bars shall be bent around pipe. No reduction in concrete quantities shall be made for pipe openings. When directed by the Engineer, a small opening in the back of the inlet shall be provided in order to drain a low area. Reinforcing bars shall extend through the opening. No reduction in concrete quantities will be made for this opening. The floor of the inlet shall be shaped as shown in various "EXAMPLES" on Reinforced Concrete Manhole Standard Drawing RD633. No addition in concrete quantities shall be made for shaping floor of inlet. No reduction in pay length of curb, gutter, or curb & gutter will be made through the inlet area. All exposed structural steel shall be painted with a coat of inorganic zinc primer and then with a top coat or a field coat of organic zinc, each coat to be 3 to 4 mils. As an alternate, the grate and frame may be hot dip galvanized after fabrication in accordance with the Standard Specifications. All structural steel shall comply with ASTM A-36, A-242, or A-441. Curb and Gutter sections shall be shaped as shown where required by the installation of curb inlets. This work shall be subsidiary to other bid items. See sheet entitled "Reinforcing Steel for Inlets and Manholes" for details and quantities.

1	01 - 2001	TAKEN FROM KDOT RD642; CHANGED FROM METRIC TO ENGLISH	CRE
NO.	DATE	REVISIONS	BY APP'D
CITY OF HUTCHINSON, KANSAS ENGINEERING DEPARTMENT			
STANDARD DETAILS FOR TYPE 10 CURB INLET			
STANDARD	DATE	January 2001	SHEET
DETAIL	Drawn By:	CRE	NUMBER
10	Approved By:	HJM	OF